THIS DRAWING IS PREPARED BY EAGLE FIRE SPRINKLER FOR USE IN CONNECTION WITH THIS PROJECT FOR USE SOLELY WITH RESPECT TO EAGLE FIRE SPRINKLER'S WORK ON SUCH PROJECT. EAGLE FIRE SPRINKLER RETAINS ALL COMMON LAW, STATUTORY AND OTHER RESERVED RIGHTS, INCLUDING COPYRIGHT. THE DRAWING SHALL NOT BE USED BY OTHERS ON OTHER PROJECTS OR FOR PERFORMANCE, COMPLETION, OR ADDITION TO THIS PROJECT BY OTHERS EXCEPT BY AGREEMENT OF EAGLE FIRE SPRINKLER IN WRITING AND WITH APPROPRIATE COMPENSATION TO EAGLE FIRE SPRINKLER.

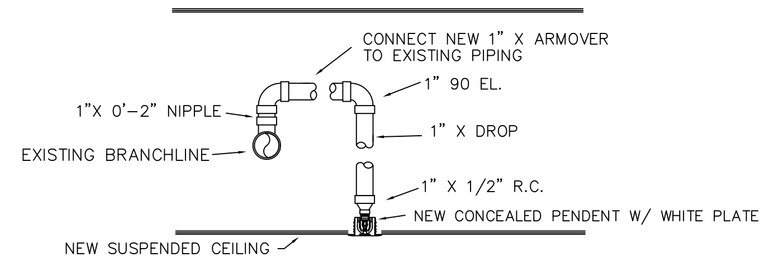

RETURN BEND DETAIL
NOT TO SCALE



HANGER DETAIL
NOT TO SCALE

GENERAL NOTES

1. STARTING OUR WORK AT EXISTING SPRINKLER PIPING. RELOCATE AND ADD FIRE SPRINKLERS AS SHOWN.
2. SPRINKLER SYSTEM IS DESIGNED IN ACCORDANCE WITH NFPA 13 "INSTALLATION OF SPRINKLER SYSTEMS".
3. THE SPRINKLER SYSTEM IS DESIGNED FOR LIGHT HAZARD.
4. OWNER TO PROVIDE ADEQUATE HEAT THROUGHOUT.
5. ALL WORK AND MATERIALS WILL BE IN ACCORDANCE WITH NFPA 13 STANDARD.
6. ALL NEW 1" PIPE SHALL BE THREADED, SCHED.40 BLACK STEEL AND JOINED BY COMPATIBLE THREADED FITTINGS.
8. INSTALLING SEMI-RECESSED OR CONCEALED PENDENT SPRINKLERS IN AREAS WITH SUSPENDED CEILING.

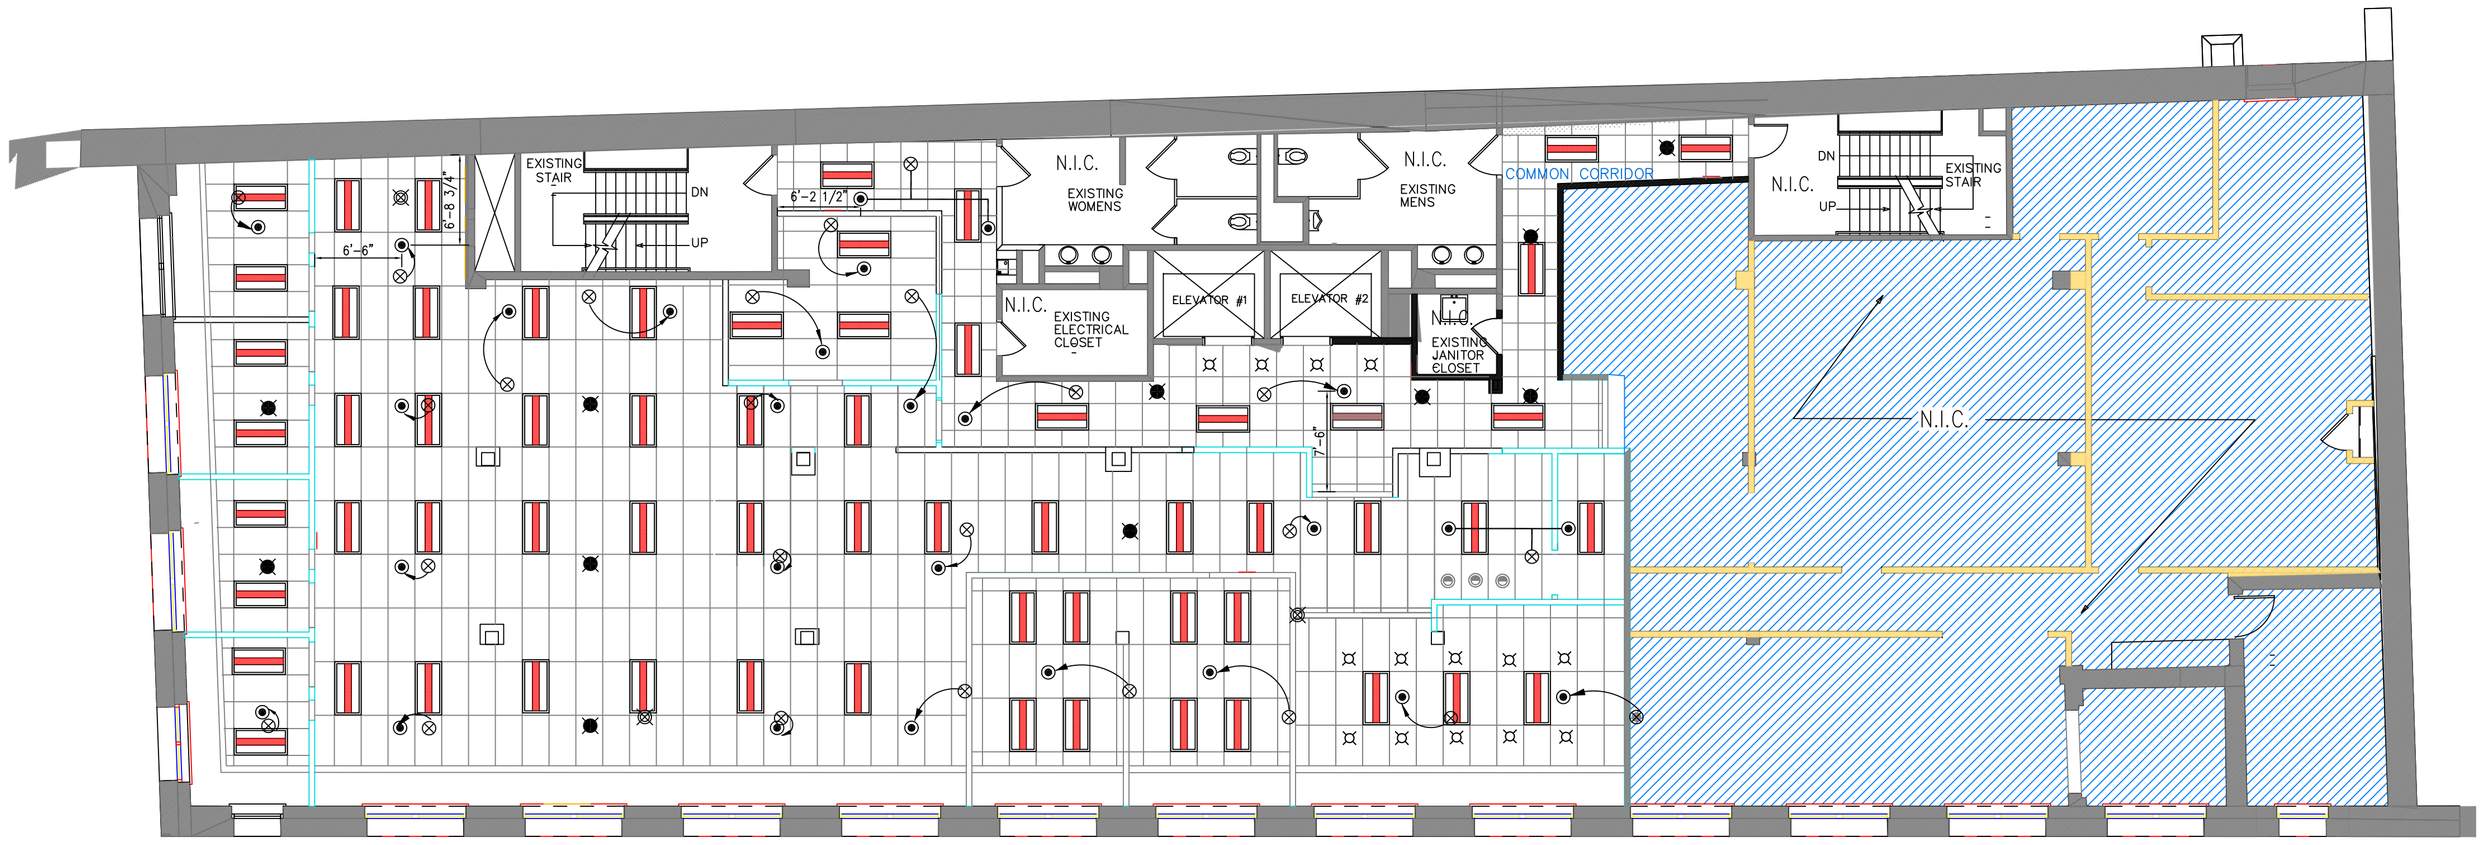

2nd FLOOR FIRE SPRINKLER PLAN

SPRINKLER HEAD LEGEND:

SYM	CNT	NAME	METAL	TEMP	K	NPT	SIN #	MFG.	MODEL#	ESCUT
◉	27	NEW PENDENT SPRINKLERS	BRASS	155	5.60	1/2"	TY3531	TYCO	RF11	WHITE PLATE
●	11	EXISTING PENDENTS TO REMAIN	BRASS	155	5.60	1/2"	TY3531	TYCO	RF11	WHITE PLATE
⊗	25	EXISTING PENDENTS TO BE RELOCATED	CHROME	155	5.60	1/2"				
⊠	3	EXISTING PENDENTS TO BE PLUGGED	CHROME	155	5.60	1/2"				

FPE STAMP

REVISIONS
DATE | DESCRIPTION | BY

Eagle Sprinkler
Fire Protection
MA. LIC. #129009
781 Main St. Whitinsville, MA 01588
(508) 234-7393

MWH
285 SUMMER STREET
BOSTON, MA

2nd Floor Fire Sprinkler Plan

PERMIT NO.
CONTRACT NO.
APPROVAL
C.O.T. DOL
SCALE 1/8" = 1'-0"
DATE 10/19/11
REVISED
PLOTTED
FP-1 of 1
Eagle Sprinkler